

Dust Resistivity Measurement and Onset of Back Corona in Electrostatic Precipitators

Muhammad Majid
Technical University
Dortmund
Germany
Muhammad.Majid@bci.tu-
dortmund.de

Helmut Wiggers
Technical University
Dortmund
Germany
helmut.wiggers@tu-
dortmund.de

Peter Walzel
Technical University
Dortmund
Germany
peter.walzel@bci.tu-
dortmund.de

1 Summary / Abstract:

Electrical resistivity of the dust, to be separated in an electrostatic precipitator, is an important parameter from the design and operation point of view. It gives the knowledge about the onset of the back corona in the system. In-situ measurements can be performed using a resistivity measurement probe. But mostly it is done in the laboratories using a measurement apparatus and the dust sample collected from the hopper beneath the precipitator. A laboratory setup will be introduced to measure the dust resistivity using a new method. Here, the onset of back corona can be detected directly during the experiment which can be eliminated immediately from the system by reducing the current by controlling the supplied voltage. Experiments were performed with a fly ash sample with $11\mu\text{m}$ and four glass samples with 75, 112, 278 and $394\mu\text{m}$ mean particle sizes. Results will be presented and discussed about the influence on resistivity results of dust resistivity measurement method: point-plate and plate-plate, mode of temperature variation: ascending and descending, air temperature, particle size and air humidity. Finally, the visualization of back corona in such systems will be presented.

2 Introduction

As the basic principle of an electrostatic precipitator, the dust particles are being charged by applying high voltages at the discharge electrodes. These charged particles leave the main air stream and move towards the collection electrodes, forming a dust layer on them as shown in Fig. 2-1. The charge emitted by the discharge electrodes accumulates on the surface of the dust layer and causes an increase of the magnitude of electric field within the layer. The dust layer itself consists of a collection of single particles with individual dielectric properties together with the gas filled voids and adsorbed water layers depending on the environmental humidity. It accommodates the distribution of accumulated surface charge to the inner body of the dust layer. Different dielectric properties of solids and gas, cause a non uniformity of the electric field with higher field strength at the contact points of the particles. Precipitators work well when the dust resistivity lies between 10^2 to $10^{10}\Omega\cdot\text{cm}$ [1]. Lower resistivity dust tends to fall off the collection electrodes and creates re-entrainment while for higher resistivity a considerable voltage gradient builds up across the dust layer, and local voltage break down of the layer could occur

which results in a glow discharge. This phenomenon is known as back corona (also stated as back discharge in literature). This corona creates ions opposite to the discharge ions, which tend to neutralize the main action of the precipitator and to re-entrain the dust into the surrounding atmosphere and the overall efficiency of an electrostatic precipitator is reduced.

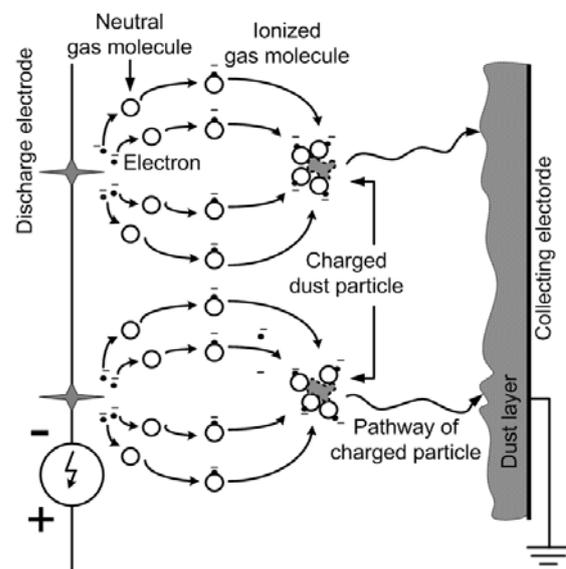


Fig. 2-1: Principle of electrostatic precipitation

Dust resistivity can be measured in-situ by installing a measurement probe inside the precipitator [2]. But mostly it is done using a laboratory apparatus such as one used by Llyod [1], White [3], Rose [4], Wiggers et al. [5-6], Lee et al. [7] etc. White [3] explained the current flow through a dust layer using two resistivity measurement methods: plate-plate and point-plate. He stated much higher inhomogeneity in current flow for the point-plate as compared to the plate-plate method. He found the maximum current flow density directly under the tip of the point electrode and smaller in the radial direction. Wiggers et al. [5-6] developed a new method for the direct detection of onset of back corona and its immediate elimination from the system with reduced current by lowering the applied voltage. They also discussed the onset of back corona under typical current densities in industrial electrostatic precipitators i.e. 0.1 - 0.5 mA/m². Three different types of dust samples, including sinter dust, fly ash and glass powder were investigated because of their different chemical composition to determine the relevant parameters of the back corona. Miller et al. [8] analyzed the influence of back corona on the current density in electrostatic precipitators. Hoferer et al. [9] performed the experiments with limestone dust to explain the strong dependence of local back corona on the dust layer thickness, the porosity and the particle size. They mentioned the higher electric field strengths within the porous dust layer as the basic reason for the onset of back corona. Rothenberg et al. [10] measured the rates of adsorption and desorption of water by coal fly ash over the temperature range 0-300 °C. They concluded that the monolayer formation by physical adsorption is usually rapid, but the micro pores fill and empty slowly over a wide range of temperatures. Kruppa et al. [11] used a point-plate method to visualize the re-entrainment of fly ash and spherical acrylic particles as a result of the back corona in the system.

3 Theoretical Model

The ohmic resistance ' R ' of the dust layer can be explained as follows:

$$R = \rho \frac{s}{A} \quad (1)$$

where ' ρ ' is the electrical resistivity, ' s ' is the thickness of the dust layer and ' A ' is the surface area of the dust carrier electrode. ' R ' can also be defined by the relation of current ' I ' passing through the dust layer as a result of

the applied voltage ' U ' across the discharge electrode:

$$R = \frac{U}{I} \quad (2)$$

$$\rho = \frac{AU}{Is} \quad (3)$$

$$\rho = \frac{U}{js} \quad (4)$$

where ' j ' is the current density.

The mean electric field strength ' E ' present in the dust layer can be calculated as:

$$E = \frac{U}{s} \quad (5)$$

$$E = \rho j \quad (6)$$

' E ' increases with the dust resistivity. At a certain level, it has enough potential to produce local electric discharges resulting in the break-down of the dust layer known as back corona. As a consequence, the field strength must be kept lower at this point to get rid of back corona.

Above described relations is the simplified explanation of the complicated phenomena taking place during the function of an electrostatic precipitator. The arrangement and shape of the dust particles and specially the contact points have a great influence on the dielectric nature of the dust layer. Inhomogeneous nature of dust particles also makes it difficult to track out the reasons of back discharge onset. Considering these complications, the above explained model yields the reliable and impressive estimate of the back corona in electrostatic precipitators. Further detail of this model has been documented by Wiggers et al. [5-6].

4 Experimental Setup

Figure 4-1 shows the schematic of the dust resistivity measurement setup. Experiments are carried out using two electrodes, made up of a porous sintered material to facilitate the humidity equilibrium between the dust layer and the surrounding gas inside the measuring chamber. The dust sample was placed on the lower electrode while the upper electrode served as the counter electrode electrode. It was connected to a laboratory high voltage unit (Heinzinger PNC 40000-5 ump). Air passes

through a temperature controlled water bath which is then introduced into the test chamber. A digital thermometer

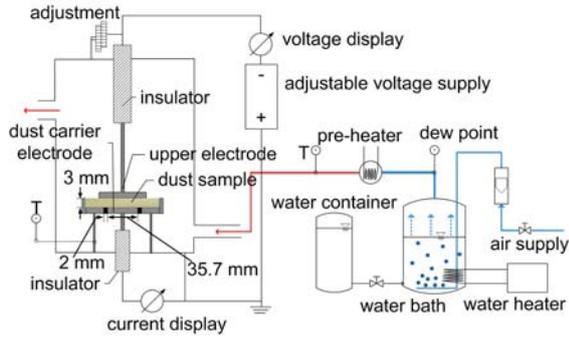


Fig. 4-1: Schematic of the dust resistivity measurement setup

was used to record the air temperature. Gas temperature entering the test chamber, was successively raised by an air heater control. The temperature ramp rate was adjusted to $< 3^\circ\text{C}/\text{minute}$ to achieve an acceptable stability of humidity exchange between the dust layer and the environmental gas [5-6]. The measurement chamber was insulated properly to minimize the heat losses. Dust temperature was measured by using a thermocouple (ERO Electronic) which contacted the outer ring of the lower electrode. A digital multi-meter was used to measure the voltage between the electrodes. Another digital multi-meter was used to register the current flowing through the dust layer.

Figure 4-2 presents the arrangements of the electrodes to be used in the two different resistivity measurement methods: pinot-plate and plate-plate. The lower plate type dust carrier electrode was fixed to the bottom of the chamber while the upper pint or plate type electrode was adjustable. Further detail of this setup can be found in Wiggers et al. [5-6].

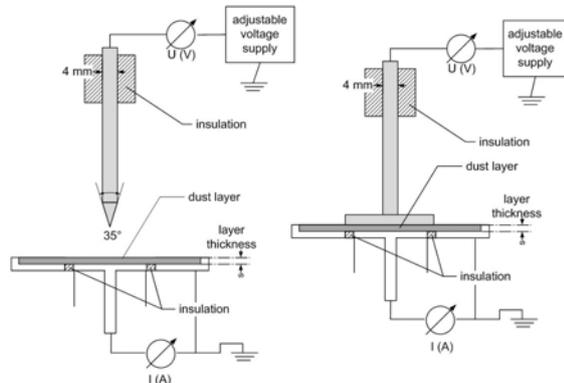


Fig. 4-2: Electrode arrangement in dust resistivity measurement chamber, left: needle-plate setup, right: plate-plate setup

Particle size distribution of the test samples was measured using a laser granulometer (CILAS 715) by dispersing the sample into the water. Scanning electron microscope pictures of the samples are also presented (Fig. 4-3).

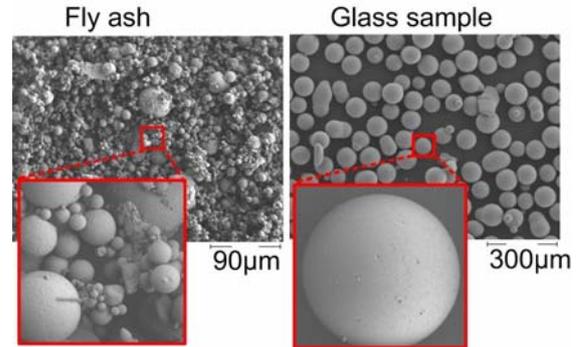


Fig. 4-3: SEM pictures of the test materials

5 Experimental Results and Discussion

5.1 Influence of measurement method on dust resistivity

Fig. 5-1 shows the resistivity of the fly ash and the current density under air dew point 20°C , as a function of temperature, using two resistivity measurement methods: point-plate and plate-plate. In point-plate method, the upper electrode was adjusted 40 mm on top of the dust layer while in the plate-plate method, the upper electrode was placed in direct contact with the dust layer with great care to minimize the compression of dust layer. In first method, the air resistivity was subtracted from air+dust resistivity. Results show that the point-plate method delivers much higher resistivity than the plate-plate method e.g. by a factor of 6 at temperature of 120°C . Both methods lead to the onset of back corona. One possible reason for the different resistivity is a marginal compaction of the dust layer by the upper electrode. For the plate-plate method, the weight of the upper electrode defines the pressure on the top of the dust layer while in point-plate method, the electric wind, also termed as ionic wind in the literature may exert some force. Kercher [12] analyzed the strength and flow profile of the electric wind in the point-plate method as a function of the shape of the point electrode and distance between the dust layer and the point electrode. He established a relationship between air velocity ' u ' and the current density ' j ' through the dust layer as:

$$u \approx \sqrt{j} \quad (7)$$

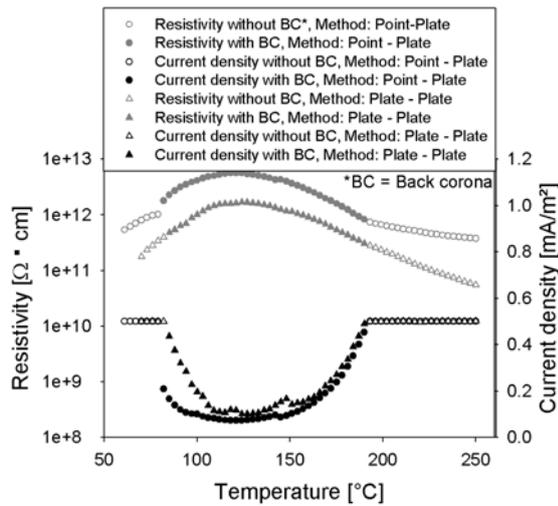


Fig. 5-1: Comparison of dust resistivity measurement methods: point-plate and plate-plate, upper two curves: dust resistivity as a function of measurement method and temperature, lower two curves: current density as a function of measurement method and temperature, layer thickness: 3 mm, air dew point: 20 °C

Another reason for higher resistivity in point-plate method is the higher water desorption rate as the dust layer is directly exposed to the surrounding air while in the plate-plate method, it is covered by the upper electrode although made from porous sinter metal.

5.2 Influence of mode of temperature variation on dust resistivity

The observation in Fig. 5-1 was further examined performing the experiment not only for the case of water desorption but also for the adsorption (method: plate-plate). This test was first performed by increasing the air temperature up to a maximum of 250 °C and then subsequently decreasing it down to 80 °C (Fig. 5-2). The two lower curves show the current density as a function of ascending and descending temperatures. The resistivity results show relative higher values for the descending temperatures but only for low temperatures, i.e. $T < 160$ °C. For higher temperatures, both curves exist very close to each other. It can be explained on the basis of irreversibility in isotherms obtained with water vapour as adsorbate and the fly ash as adsorbent [10]. Further, the back corona was observed in both modes: for ascending temperatures, it lasted from 90 °C to 195 °C whereas for descending temperatures, it

expanded itself between 70 °C and 195 °C. Desorption rate increases with increasing temperature and achieves a peak value at $T \approx 125$ °C. This is caused by desorption of physically adsorbed water molecules [10].

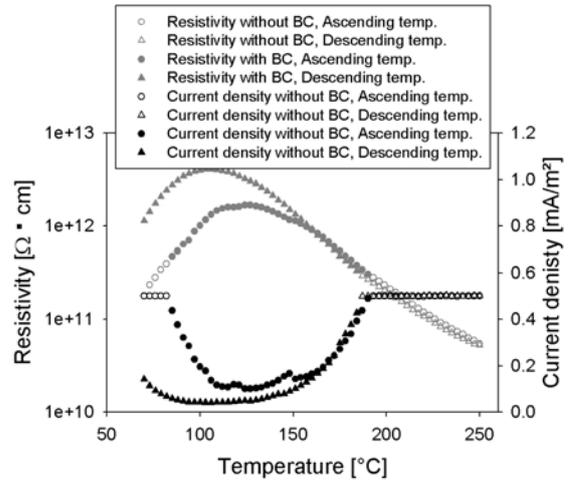


Fig. 5-2: Upper: dust resistivity as a function of temperature, mode of operation (ascending/descending temperature) and humidity, lower: current density as a function of temperature, mode of operation (ascending/descending temperature) and humidity, air point point: 20 °C, layer thickness: 3 mm, method: plate-plate

Desorption rate starts decreasing with further increase in temperature which is controlled by the removal of water molecules from the inner body of particles. For descending temperature, water starts to adsorb on particle surface but probably not so quick as it desorbed in case of ascending temperature. Rothenberg et al. [10] obtained the hysteresis loops for adsorption and desorption of pure water vapour to fly ash sample using BET measurement method. At constant temperature (20 °C), for the desorption case, the amount of water residual in the sample was 12.5 mg/g while it is reduced to 6 mg/g for adsorption. The specific surface area (S_g) of this material was 2.1 m²/g. In our case, S_g was measured with a Gemini 2360 surface area analyzer, using BET measurement method and found to be 1.069 m²/g.

5.3 Influence of particle size on dust resistivity

In Fig. 5-3, resistivity of the four glass samples with mean particle sizes, $d_{p,50}$ 75, 112, 278 and 394 μm, has been plotted against the air temperature under current density 0.5 mA/m² and air dew point 40 °C. The results show that the resistivity is different for different mode of experiments (ascending and descending) up to

air temperature $T = 170^\circ$. In temperature range of $T = 180\text{-}190^\circ\text{C}$, all curves stay fairly close to each other. For low temperatures i.e. $T < 170^\circ\text{C}$, the current flows through the particle surface which is strongly influenced by the presence of water layer on the particle surface. At higher temperatures, water desorbs from the particle surface and the conduction takes place through the core of the particles. Here, the chemical composition of the material

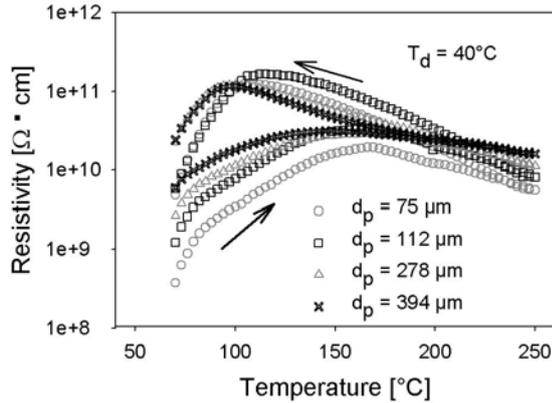


Fig. 5-3: Influence of particle size on dust resistivity, $s = 3\text{ mm}$, method: plate-plate

plays a dominant role. Further, in case of ascending temperatures, the resistivity of the smaller particles is less than the bigger ones for low temperatures i.e. $T < 170^\circ\text{C}$, while in case of descending temperatures, the smaller particles have higher resistivity. Additionally, the difference in the resistivity for ascending and descending temperatures gets smaller with the increase in the particle size. To determine the possible reasons of such phenomena, firstly, the porosity ' ε ' of the samples was considered. According to Stieß [13], the porosity of an irregular packing of the mono-dispersed particles does not change remarkably for the non-cohesive and free flowing granular media with particle size above $100\ \mu\text{m}$. Porosity of our test samples was calculated experimentally and the results are shown in Table 5-1. It can be seen that it does not change by big margins with change in the particle size. Under such circumstances, it can be concluded in our case that the porosity was not amongst the highly influencing parameter.

Next, the spec. surface area was considered as the influencing parameter. Naganuma et al. [14] measured the spec. surface area of the four glass particle samples with mean particle diameters of 26, 42, 59 and $85\ \mu\text{m}$ with N_2 and Kr gases using a surface area pore size analyzer (BEL SORP 36, Nihon Bell Corp., Tokyo, Japan). They found that the specific surface of the glass particles increases with decrease in the average particle size. The

presence of higher moisture content for the smaller particles due to their higher spec. surface area could be one possible reason for the observations in Fig. 5-3.

Table 5-1: Porosity of the test glass samples

d_p (μm)	75	112	278	394
ε (%)	37.9	36.9	35.1	35.6

5.4 Influence of air humidity on dust resistivity

To understand the role of water content for the dust resistivity more clearly, the fly ash sample was tested under three different air dew points ' T_d ' i.e. 25°C , 40°C and 55°C respectively. For the case of ' T_d ': 25°C , the material shows the maximum resistivity $2 \times 10^{12}\ \Omega\cdot\text{cm}$ at air temperature 130°C (Fig. 5-4). The onset of back corona was observed for the temperature range $90 - 190^\circ\text{C}$. Further, ' T_d ' was increased to 40°C , keeping the same other experimental conditions. In doing so, the maximum resistivity decreased to $5 \times 10^{11}\ \Omega\cdot\text{cm}$ at the same air temperature. The back corona region was also reduced between $115 - 170^\circ\text{C}$. Complete elimination of back corona was observed with dew point 55°C while the maximum resistivity was also decreased to $2 \times 10^{11}\ \Omega\cdot\text{cm}$.

5.5 Visualization of back corona

To visualize the onset of back corona during the resistivity measurement, a high speed camera HSS3 LaVision was added to the experimental setup explained in section 4. Experimental conditions were set to the dust layer thickness 3 mm and air dew point 20°C using point-plane method. At an inter-electrode distance of 29 mm , the electric wind was too strong, which resulted in particle re-entrainment right from the beginning of the test. At an inter-electrode distance of 41.5 mm , it was possible to visualize the back corona in form of tiny light glows on the dust layer surface. Back corona started at air temperature 80°C and lasted till 180°C . At the start of the experiment, the upper surface of the dust layer was almost smooth which can be seen in Fig. 5-5 a. It also shows the light glow at just the start of the back corona in the system. Due to the continuous back corona, a small amount of dust particle was continuously blown into the air from the upper surface of the dust layer

which made it very rough. It is shown in Fig. 5-5 b, which also shows the blow or re-entrainment of the dust particles into the surrounding environment as a result of the back corona.

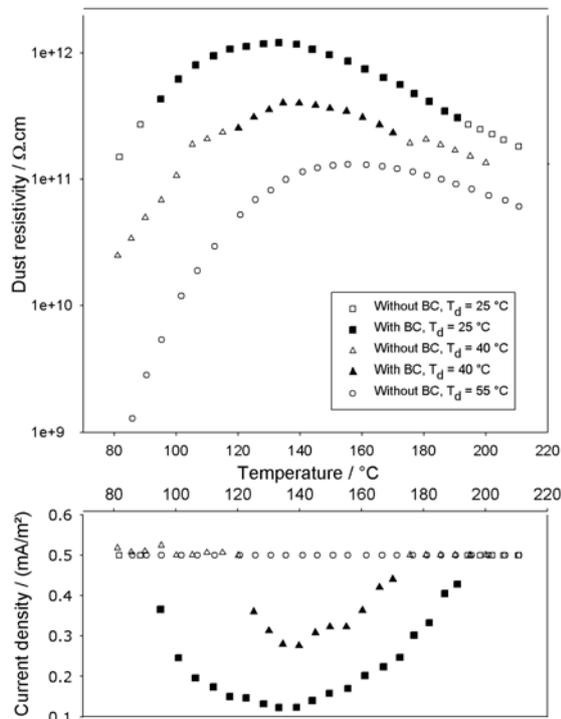


Fig. 5-4: Influence of air humidity on the dust resistivity, $s = 2.5$ mm, method: plate-plate

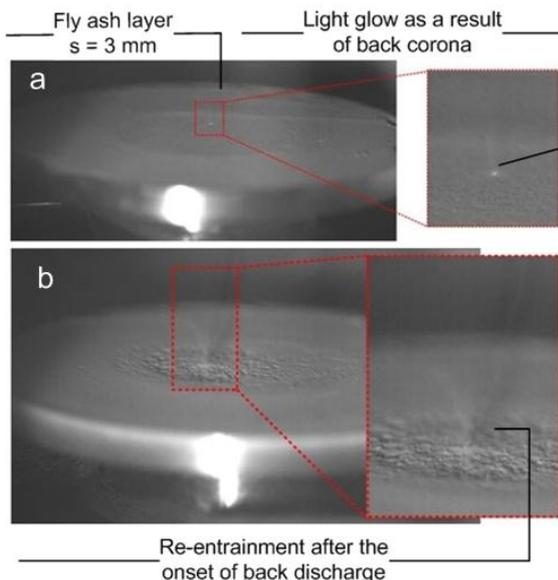


Fig. 5-5: Visualization of back corona in the fly ash layer, inter-electrode distance: 41.5 mm, air dew point: 20°C, a) Visible light glow, b) Blow or re-entrainment of the dust particles

6 Literature

- [1] Lloyd, D. A.; Electrostatic precipitator handbook; IOP Publishing Ltd. England; 1998; pp. 65-67
- [2] Instruction manual; Wahlco resistivity probe, revised version; USA; 1985
- [3] White, Harry J.; Industrial electrostatic precipitators; Addison-Wesley Publishing Company, Inc.; USA; 1963
- [4] Rose, H.E. and Wood A. J.; An introduction to electrostatic precipitation in theory and practice; Constable & Company Ltd.; England; 1956; pp. 123-127
- [5] Wiggers, H.; Measurement of dust resistivity - Back corona in electrostatic precipitators; VGB PowerTech, No. 3; Germany; 2007; pp. 93-96
- [6] Wiggers, H. and Nasri, S.; Staubwiderstandsmessungen bei Elektrofiltertypischen Stromdichten; Gefahrstoffe - Reinhaltung der Luft 68, No. 5; Germany; 2008; pp. 177-181
- [7] Lee, J. K., Hyun, O. C. and Lee, J. E.; KSME International Journal, Volume 15, No. 5; South Korea; 2001; pp. 630-638
- [8] Miller, J., Hoferer, B. and Schwab, A.; Feinstaubabscheidung in betriebsoptimierten Elektrofiltern, Teil II, PEF - Projekt; Europäisches Forschungszentrum für Maßnahmen zur Luftreinhaltung; Germany; 1977
- [9] Hoferer, B. and Schwab, A.; Local occurrence of back corona at the dust layer of electrostatic precipitators; Conference on electrical insulation and dielectric phenomena; 1977; pp. 93-96
- [10] Rothenberg, S. J. and Cheng, Y. S.; Coal combustion fly ash characterization - Rates of adsorption and desorption of water; The Journal of Physical Chemistry, Vol. 84, No. 12; USA; 1980; pp. 1644-1649
- [11] Krupa, A., Lackowski, M. and Czech, T.; Dust particles motion in back discharge; Journal of Physics, Conference Series 142; Poland; 2008; pp. 1-4
- [12] Kercher, H.; Elektrischer Wind, Rücksprühen und Staubwiderstand als Einflußgrößen im Elektrofilter; VDI-Z. Series 6 Nr. 27, Germany; 1970; pp. 52
- [13] Stieß, M.; Mechanische Verfahrenstechnik 1, 2nd Edition; Springer-Verlag Berlin; 1998; pp. 64-67
- [14] Nganuma, T., Kagawa, Y.; Effect of particle size on light transmittance of glass particle dispersed epoxy matrix optical composites; Acta mater. Vol. 47, No. 12; Japan; 1999; pp. 4321-4327